


HARD SURFACING	SURFACE REQUIREMENTS	BASE ROCK REQUIREMENTS
CONCRETE	6" MIN 3,300 PSI PCC PVMT	4" MIN OF 1"-0" GRANULAR BASE ROCK
ASPHALT CONCRETE PAVEMENT	3" MIN ASPHALT CONC PVMT	8" MIN OF 1"-0" GRANULAR BASE ROCK



**NOTES:**

1. NEW DRIVEWAY APPROACH MAY BE SLOPED DIRECTLY TOWARDS THE EXISTING EDGE OF PAVEMENT WHERE SPECIFICALLY APPROVED BY THE CITY.
2. ALL HARD SURFACING MATERIALS INCLUDING ASPHALT CONCRETE PAVEMENT, GRANULAR BASE ROCK, TRENCH BEDDING, PIPE ZONE, AND BACKFILL SHALL BE COMPACTED IN ACCORDANCE WITH THE PUBLIC WORKS STANDARDS. CONCRETE SHALL HAVE A MINIMUM 28-DAY COMPRESSIVE STRENGTH OF 3,300 PSI.
3. CITY APPROVED DRIVEWAY APPROACH LOCATIONS WITH ROADSIDE DITCHES SHALL BE PROVIDED WITH A CULVERT CROSSING AS SHOWN. DRIVEWAY CULVERT SIZE AND MATERIAL SHALL BE AS REQUIRED BY THE CITY (12" MIN).

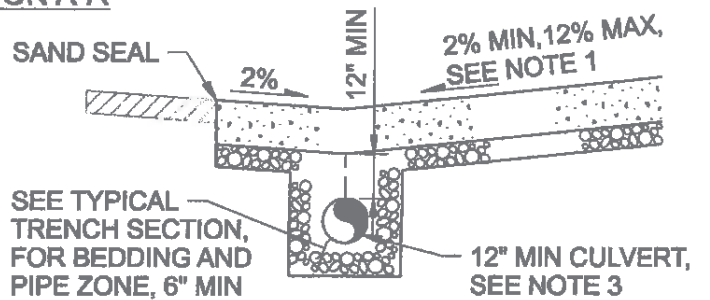

The selection and use of this Standard Drawing, while designed in accordance with standard engineering principles and practices, is the sole responsibility of the User.

REVISIONS

STANDARD DRAWING TITLE

**TYPICAL RESIDENTIAL DRIVEWAY APPROACH FOR UNIMPROVED STREETS**

NO SCALE

DIVISION

STREET

DRAWING NO.

**X-1**